

CHAPTER 4

ACCOMMODATION OF MOVEMENT



ACCOMMODATION OF MOVEMENT

Overall Movement

All buildings are subjected to varying degrees of dimensional change after being built. Many factors affect movement, such as the temperature and moisture changes of the surrounding atmosphere, the characteristics of the masonry and mortar, the degree of restraint imposed by foundations, roof trusses and suspended slabs, and the imposed loads on the walls.

In general, it is simpler to adopt empirical rules rather than to try and estimate movement in a building from first principles. SANS 10249: Masonry Walling has a section on movement in masonry.

Thermal Movement

An increase in the temperature of a wall will induce expansion. The degree of movement is equal to the temperature range

multiplied by the appropriate coefficient of thermal movements overcoming restraint in the wall itself (see Table 4.1). A decrease in temperature will result in the shortening of the wall that may induce cracks. However, the movement that actually occurs within a wall after construction depends not only on the range of temperatures, but also on the initial temperatures of the units as laid, their moisture content and the degree of restraint. To determine the effective free movement that could occur, therefore, some estimation of the initial temperature and temperature range has to be made. The effective free movement that is calculated should still be modified to allow for the effects of restraints.

Table 4.1 : Linear thermal movement of masonry units and mortar

LINEAR THERMAL MOVEMENT OF MASONRY UNITS AND MOTAR		
Material	Coefficient of linear thermal movement $C \times 10^{-6}$	Movement per 10m of wall for 50°C temperature change (mm)
Burnt masonry units (see note 1)	4 - 8	2 - 4
Concrete masonry units (see note 2)	7 - 14	3,5 - 7
Mortars	11 - 13	5,5 – 6,5

Note:
 1. Thermal movement of burnt clay masonry units depends on the clay mixture and its firing
 2. Thermal movement of concrete masonry units depends on type of aggregate and mix of proportions

Irreversible Moisture Expansion Movement

The continuing expansion of bricks justifies earlier recommendations to avoid problems in buildings. Building problems caused by the expansion of bricks can be avoided by using a lean mortar mix that can accommodate at least some of the expansion, avoiding designs such as short offsets in long runs of brickwork and by incorporating adequate movement joints.

SANS 10249 refers to an accepted categorization of clay masonry units according to average moisture expansion for the 96 h standard steam test, i.e. category I is < 0,05 %, Category II is 0,5 to 0,10 % and category III being 0,10 to 0,20 %.

Moisture Content Movement

Burnt clay units exhibit little movement with changes in moisture content. Movement is normally not more than 1mm in every 10m of length and rarely more than 2mm in every 10m of length. This movement is reversible.

Movement in Adjoining Structures


Structural movement in adjoining concrete or steel structures can cause distress. Distress can occur in either supported or enclosed brickwork, and can arise from elastic and creep deformation and deflection under stress, and from shrinkage in the case of reinforced concrete components.

Problems can arise when elements supporting masonry walls, such as foundations and suspended concrete floor and roof slabs, deflect and impose unanticipated stresses on the brickwork. Infill brickwork panels in reinforced concrete framed buildings can be stressed because of the shortening of the concrete columns due to elastic and creep stresses and shrinkage of the concrete (normal 1,2 to 1,5mm/m for shortening of columns). Thus, the top of infill panels must be separated from the structural member above by a gap of between 5 and 12mm.

Provision of Control Joints


Movement in masonry can be accommodated by designing the masonry so that it is separated into discrete panels through the provision of control (movement) joints that reduce stress build-up. The design and positioning of control joints should accommodate movements but should not impair the stability of the wall or any of its functions such as impermeability, sound insulation and fire-resistance.

Figures 4.1, 4.2 and 4.3 show the position of control joints in buildings and free-standing walls.

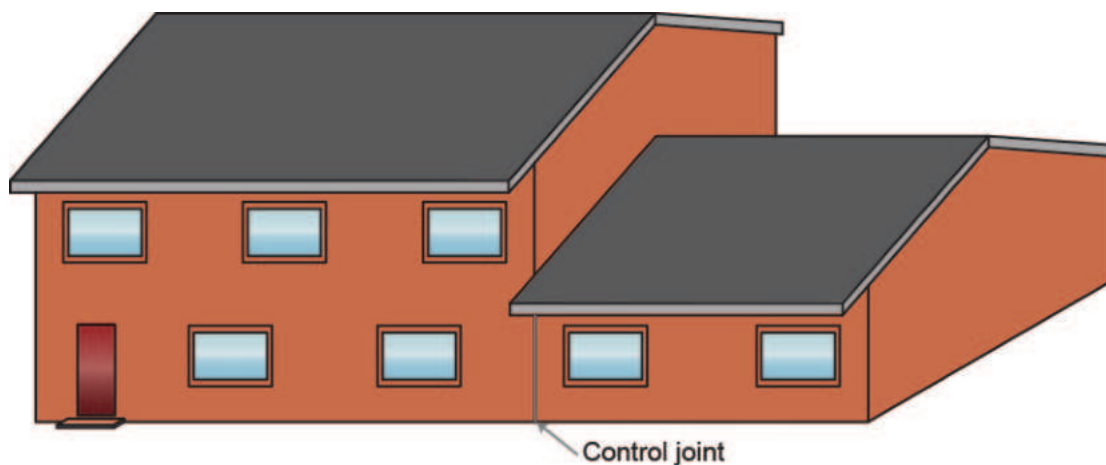

Control joint at change in external wall height


4.1 - Location of control joints in buildings

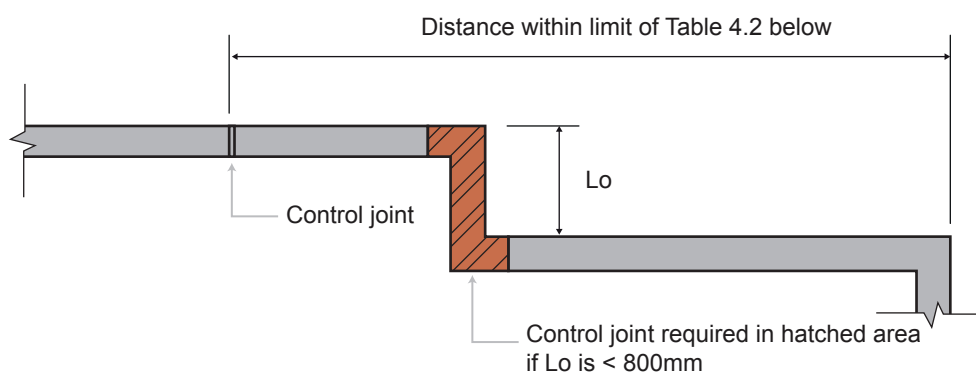

4.2 - Position of control joints at set backs

Table 4.2: Maximum Vertical Control Joint Spacing in Walls

MAXIMUM VERTICAL CONTROL JOINT SPACING IN WALLS			
Unit type	Moisture expansion (%)	Appropriate spacing of vertical joints 10-12mm wide	
		Free standing wall (m)	Housing units (m)
Unreinforced			
Burnt clay	<0,05	16	18
	0,05 - 1,0	10	14
	0,10- 0,20	6	10
Masonry with bed joint reinforcement			
Burnt clay	<0,05	16	18
	0,05 - 1,0	12	16
	0,10- 0,20	8	12

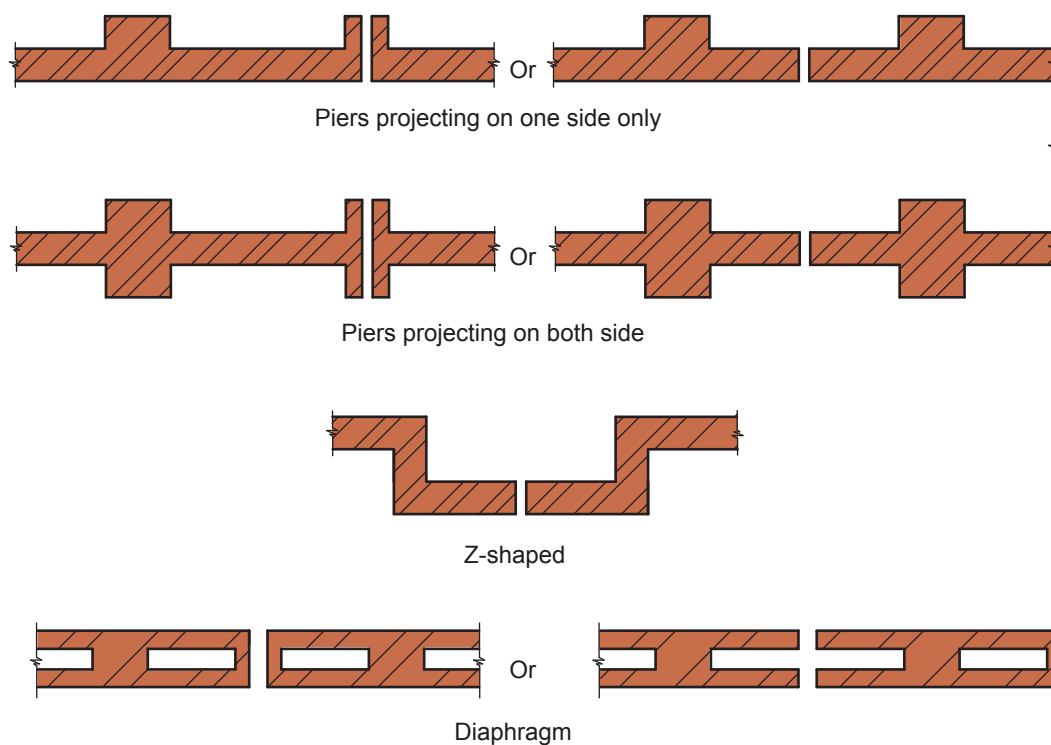

4.3 - Location of control joints in free-standing walls

Table 4.3 - Free-standing walls (solid units)

FREE STANDING WALLS (SOLID UNITS)			
Nominal wall thickness (T)	Maximum height (H)	Nominal dimensions of piers (overall depth x width)	Maximum pier spacing (centre - centre)
mm	m	mm	m
No Piers			
90	0,8		
110	1,0		
140	1,3		
Z-shaped			
90	1,8	390 x 90	1,2
90	2,0	490 x 90	1,4
110	1,6	330 x 110	1,5
110	2,1	440 x 110	1,5
140	2,2	440 x 140	2,0
140	2,5	590 x 140	2,5
Piers projecting on side			
90	1,4	290 x 290	1,4
90	1,5	390 x 290	1,6
90	1,7	490 x 290	1,6
110	1,5	330 x 330	1,8
110	1,5	440 x 330	1,8
110	1,9	550 x 330	2,0
140	1,7	440 x 440	2,2
140	1,8	590 x 390	2,5

